

COMMONWEALTH OF KENTUCKY  
BEFORE THE PUBLIC SERVICE COMMISSION

In the Matter of:

APPLICATION OF CUMBERLAND COUNTY WATER )	CASE NO.
DISTRICT TO DEVIATE FROM THE REQUIREMENTS )	2010-00481
OF 807 KAR 5:066, SECTION 4(4), REGARDING )	
WATER STORAGE )	

O R D E R

On December 7, 2010, the Cumberland County Water District ("CCWD") applied for permission to deviate from 807 KAR 5:066, Section 4(4), which requires that each utility maintain minimum water storage of one day's supply of its average daily usage. CCWD states in its application that its average daily water usage, including unaccounted-for water, is approximately 590,000 gallons, and that its current water storage capacity is 500,000 gallons.

The Commission, having reviewed the application and being otherwise sufficiently advised, finds that:

1. CCWD is not in compliance with 807 KAR 5:066, Section 4(4).
2. CCWD states in its application that it has been working with its engineer and the Kentucky Infrastructure Authority to secure funding for a new storage tank.<sup>1</sup>
3. Because of the time needed to plan, finance, and construct water storage facilities, CCWD should be granted a deviation from 807 KAR 5:066, Section 4(4), until January 1, 2016.


---

<sup>1</sup> See <http://wris.ky.gov/portal/DwPrjData.aspx?PNUM=WX21057016> (last visited Feb. 7, 2011).


IT IS THEREFORE ORDERED that:

1. CCWD is granted a deviation from 807 KAR 5:066, Section 4(4) until January 1, 2016.
2. CCWD shall take all necessary actions to bring its water storage facilities into compliance with 807 KAR 5:066, Section 4(4) prior to January 1, 2016.
3. This case is closed and shall be removed from the Commission's docket.

By the Commission

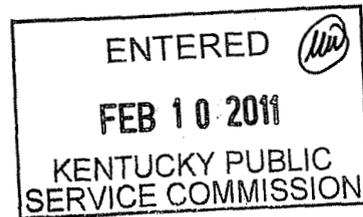

ATTEST:

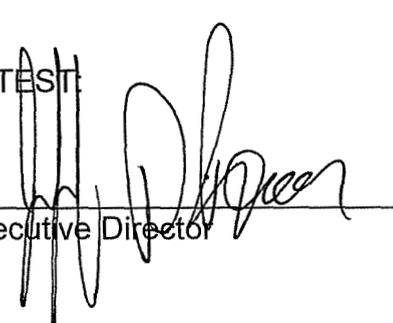  
Executive Director

Case No. 2010-00481

Johnny Carter  
General Manager  
Cumberland County Water District  
133 Lower River Street  
Burkesville, KY 42717-9622